


1 A-2 EAST ELEVATION
1/8" = 1'-0"




2 A-2 WEST ELEVATION
1/8" = 1'-0"

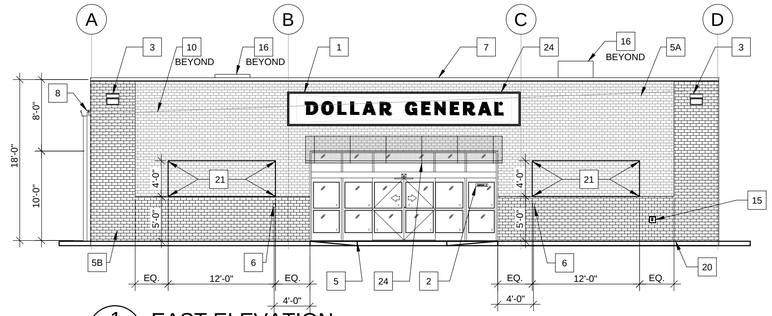


3 A-2 NORTH ELEVATION (TRUCK SIDE)
1/8" = 1'-0"

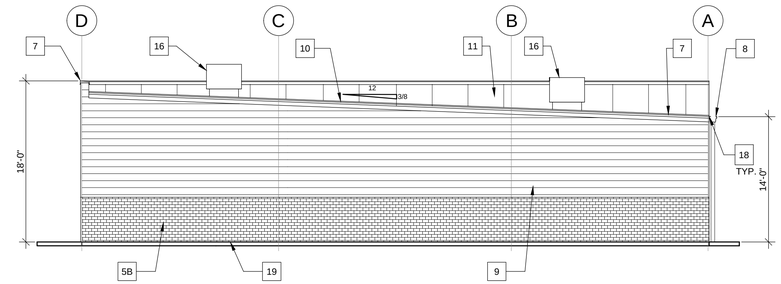


4 A-2 SOUTH ELEVATION
1/8" = 1'-0"

## ELEVATION KEYED NOTES

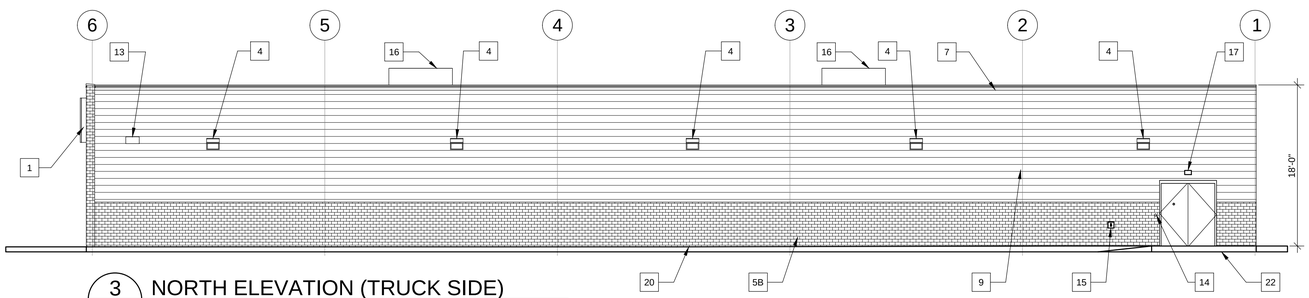1. SIGN FURNISHED AND INSTALLED BY DOLLAR GENERAL CORP. WITH CIRCUIT AS NOTED ON ELECTRICAL PLAN. SIGN TO BE CENTERED ON FRONT OF BUILDING. CONTRACTOR IS TO PROVIDE ADEQUATE BLOCKING AS REQUIRED BY SIGN MANUFACTURER TO SUPPORT SIGN WEIGHT OF UP TO 1,400 LBS. EXTERIOR CANOPY SIGN SHALL BE SUPPORTED BY THE FACE OF THE CANOPY. COORDINATE THE PROPER SIGNAGE TO BE USED WITH DOLLAR GENERAL.
2. ADDRESS ABOVE DOOR MOUNTED ON CENTER PANE OF GLASS. ADDRESS TO BE 10"-12" VINYL CUT NUMBERS. COLOR: BLACK W/WHITE OUTLINES.
3. WALL PACK. 16'-6" A.F.F. TO TOP OF WALL PACK. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
4. WALL PACK 12'-0" A.F.F. TO TOP OF WALL PACK. REFER TO E-2 FOR ADDITIONAL INFORMATION.
5A. ENDURAMAX WALL SYSTEM. MORENCY STONE "LIGHT GRANITE" BRICK UNIT WITH POLYSTYRENE PANEL.
5B. ENDURAMAX WALL SYSTEM. GLEN-GERY "AUTUMN OAK" BRICK UNIT WITH POLYSTYRENE PANEL.
6. RECEPTACLE. REFER TO E-1 FOR ADDITIONAL INFORMATION. CMU CUT IN HALF AND REVERSE INSTALLED.
7. METAL COPING - SEE THIS SHEET FOR COLOR.
8. GUTTER AND DOWNSPOUT - SEE THIS SHEET FOR COLOR.
9. HARDIE PLANK LAP SIDING. COLOR: SAIL CLOTH.
10. STANDING SEAM METAL ROOF. GALVALUME FINISH.
11. METAL FASCIA PANELS, SEE THIS SHEET FOR COLOR.
12. PRE-FINISHED METAL WALL PANELS (BY PEMB). PROVIDE TAMPER- RESISTANT FASTENERS 8'-0" A.F.F. AND BELOW. SEE THIS SHEET FOR COLOR.
13. VENT FOR BATHROOM EXHAUST. REFER TO M1 FOR ADDITIONAL INFORMATION.
14. DOOR BUZZER. REFER TO E-1 FOR ADDITIONAL INFORMATION.
15. WALL HYDRANT. REFER TO P-1 FOR ADDITIONAL INFORMATION. CMU CUT IN HALF AND REVERSE INSTALLED WHERE APPLICABLE.
16. HVAC UNITS MOUNTED ON ROOF. REFER TO MECHANICAL SHEET M-1 FOR MORE INFORMATION.
17. OUTSIDE AIR TEMP. SENSOR MOUNTED OVER RECEIVING DOORS @ 8'-0" A.F.F.
18. MINIMUM EAVE HEIGHT IS 14'-0" A.F.F.
19. FINISHED GRADE AT EXTERIOR WALLS SHALL BE A MINIMUM OF 6" BELOW FINISHED FLOOR AT ALL NON PAVED AREAS.
20. HARD SURFACE AT EXTERIOR WALLS SHALL BE A MINIMUM OF 2" BELOW FINISHED FLOOR AT PAVED AREAS.
21. 1/2" DIAMETER x 6" LONG STAINLESS STEEL EYE BOLTS (CLOSED) WITH 1" DIAMETER OPENINGS. DRILL AND EPOXY INTO BLOCK WALL. 4 BOLTS TO BE LOCATED AS SHOWN EACH SIDE OF ENTRY, TOTAL OF 8 BOLTS.
22. SLOPE CONCRETE AT ENTRANCE AND EXIT LOCATION.
23. ELECTRIC METER. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
24. AWNING BY GENERAL CONTRACTOR. COLOR: BLACK. SEE SHEET A-3B AND STRUCTURAL SHEETS FOR MORE INFORMATION

## GENERAL NOTES

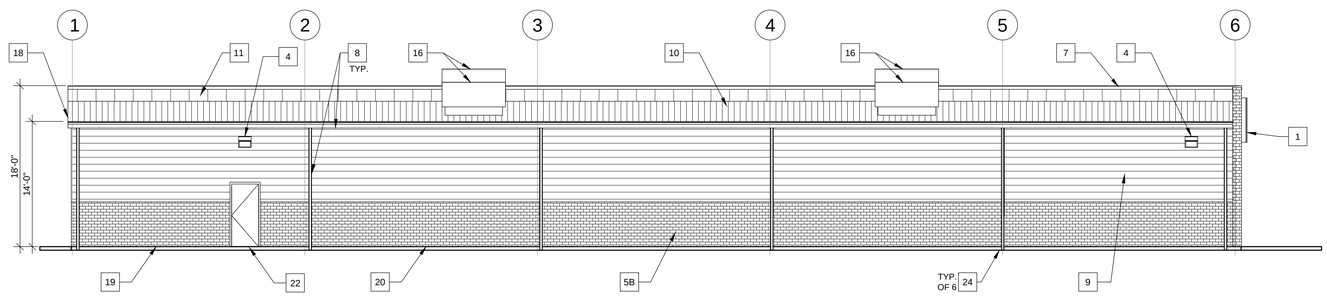1. G.C. TO CAULK AND SEAL ALL PENETRATIONS.
2. G.C. TO CAULK ALL DISSIMILAR MATERIALS AND GAPS.
3. G.C. TO INSTALL ADDRESS NUMBERS ON TRANSOM GLASS ABOVE MAIN DOOR ENTRY.
4. G.C. TO INSTALL KNOX BOX PER LOCAL JURISDICTIONAL REQUIREMENTS. SURFACE OR FLUSH MOUNT.

| PRE-ENGINEERED METAL BUILDING VENDOR | VP BUILDINGS ATTN: DAVID ENGLISH (901) 568-4537 DEnglish@vp.com | | | | | STAR BUILDING SYSTEMS ATTN: JEFF HORN (866) 664-8899 | | | | | NUCOR BUILDING SYSTEMS ATTN: BOB BARRY (315) 622-4440 (260) 837-7891 | | | | | BIG BEE STEEL BUILDINGS, INC. ATTN: KEVIN BUSLER (800) 633-3378 | | | | | CHIEF BUILDINGS ATTN: ERIN SULLIVAN (308) 385-4628 (308) 390-8199 | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| EXTERIOR FINISHES<br>EXTERIOR FINISHES ARE TO MATCH OR BE EQUAL TO VP METAL BUILDING SYSTEM'S FINISH SELECTION. | COOL EGYPTIAN WHITE | COOL DARK BRONZE | BRONZE | COOL COTTON WHITE | GALVALUME | LIGHTSTONE | MEDIUM BRONZE KYNAR 500 | BRONZE | POLAR WHITE | GALVALUME | LIGHTSTONE | MEDIUM BRONZE KYNAR 500 | BRONZE | POLAR WHITE | GALVALUME | SANDSTONE | BURNISHED SLATE | BRONZE | POLAR WHITE | GALVALUME | PARCHMENT | ANTIQUE BRONZE | BRONZE | POLAR WHITE | GALVALUME |
| GUTTERS & DOWNSPOUTS | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● | | | | |
| RECEIVING & EMERGENCY EXIT DOORS (EXTERIOR OF DOORS TO BE PAINTED, REFER TO DOOR SCHEDULE) | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● | | | | |
| ENDURAMAX WALL SYSTEM. MORENCY STONE CONCRETE BRICK UNIT W/ PRE-MOLDED POLYSTYRENE PANEL. (5A) | LIGHT GRANITE | | | | | LIGHT GRANITE | | | | | LIGHT GRANITE | | | | | LIGHT GRANITE | | | | | LIGHT GRANITE | | | | |
| ENDURAMAX WALL SYSTEM. GLEN-GERY CONCRETE BRICK UNIT W/ PRE-MOLDED POLYSTYRENE PANEL. (5B) | AUTUMN OAK | | | | | AUTUMN OAK | | | | | AUTUMN OAK | | | | | AUTUMN OAK | | | | | AUTUMN OAK | | | | |
| FLAT METAL SOFFIT AT STOREFRONT VESTIBULE AREA | | | | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● | |
| BUILDING FASCIA PANEL | | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● | | | |
| NABCO STOREFRONT SYSTEM | | | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● | | |
| STANDING SEAM METAL ROOF PANELS | | | | | ● | | | | | ● | | | | | ● | | | | | ● | | | | | ● |
| HARDIE PLANK LAP SIDING - KEYNOTE #9 | SAIL CLOTH | | | | | SAIL CLOTH | | | | | SAIL CLOTH | | | | | SAIL CLOTH | | | | | SAIL CLOTH | | | | |

NOTE:
1. REFER TO SHEET F-1 FOR ADDITIONAL INFORMATION ON RECOMMENDED NATIONAL ACCOUNT VENDORS.
2. NATIONAL ACCOUNT AND CONTACT INFORMATION SUBJECT TO CHANGE.

## PRE-ENGINEERED METAL BUILDING NOTES

METAL BUILDING NOTES:

1. THE PRE-MANUFACTURED METAL BUILDING STRUCTURE, CONCRETE FOUNDATION, AND INTERIOR CONCRETE SLAB SHALL BE DESIGNED, DETAILED, FABRICATED, AND CONSTRUCTED IN ACCORDANCE WITH ALL APPLICABLE CODES, STANDARDS AND REGULATIONS. THE MOST STRINGENT REQUIREMENTS APPLY WHERE INCONSISTENCIES OCCUR BETWEEN THE APPLICABLE STANDARDS. IN THE ABSENCE OF OTHER CRITERIA, LOADINGS SHALL CONFORM TO THE 2012 EDITION OF THE NORTH CAROLINA BUILDING CODE.
2. THE SCOPE OF THE PRE-MANUFACTURED METAL BUILDING STRUCTURE SHALL INCLUDE THE DESIGN, ENGINEERING, FABRICATION, DELIVERY, AND ERECTION OF THE COMPLETE STRUCTURAL STEEL FRAMING AND EXTERIOR SKIN PACKAGE. THE METAL BUILDING MANUFACTURER SHALL BE CERTIFIED BY AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) METAL BUILDING CERTIFICATION PROGRAM.
3. THE FRONT FASCIA SHALL HAVE (3) 12" PURLINS (MOUNTED VERTICALLY SO THAT THE 12" FACE IS AGAINST THE BUILDING METAL SIDING. THESE PURLINS SHALL BE CENTERED OVER THE ENTRANCE AND SPACED 96" APART TO PROVIDE ADEQUATE SUPPORT FOR SIGNAGE WHICH MAY WEIGH UP TO 1,400 LBS.

ROOF NOTES:

1. METAL ROOF MUST BE A STRUCTURAL STANDING SEAM METAL ROOF WITH MECHANICALLY ROLLED SEAMS. SEAMS TO BE A MINIMUM 1 1/2" HIGH. ALL FASTENERS TO BE CONCEALED.
2. ROOF PANELS TO BE A MINIMUM 24 GAUGE.
3. METAL ROOF SYSTEM TO BE EQUAL TO VP BUILDING SLR II ROOF.
4. CONDENSATE FROM HVAC UNITS TO BE PIPED TO GUTTERS.

GPD Engineering and Architecture Professional Corporation - 52715
520 South Main Street, Suite 2531
Akron, OH 44311
330.572.2100 FAX 330.572.2101
Copyright; GPD Engineering and Architecture Professional Corporation 2015

DOLLAR GENERAL

| REV. | DATE | DESCRIPTION |
|---|---|---|

DOLLAR GENERAL
SR 1001 & PROVIDENCE CHURCH RD.
SALISBURY, NC 28146

EXTERIOR ELEVATIONS & FINISH SCHEDULE

| ISSUED FOR: | |
|---|---|
| PERMIT | - |
| BID | - |
| CONSTRUCTION | - |
| RECORD | - |

| PROJECT MANAGER | DESIGNER |
|---|---|
| MAR | CDL |

JOB NO. 2016192.13

A-2

Drawing Name: O:\2016\2016192\13 Salisbury NC\Dwg\Bldg\110_A2_EXTERIOR ELEVATIONS.DWG
User: akoltesar